

PRODUCT DATA SHEET

www.internationalgasdetectors.com

OLIVER IGD

Control Systems

Transmitters

Sensors

Accessories

TOCSIN 102 Series Infra Red Gas Detectors

4-20mA Device 3 Wire

- Addressable Versions
- Compact Size
- EExd Certified
- ATEX Certified
- Ingress Protection IP66

Available as:

- 0- 100% LEL (State Flammable Gas)
- 0- 100% Volume (as Methane)
- 0- 5000ppm CO2
- 0- 5% Volume CO2
- 0- 100% Volume CO2


Tocsin 102 Series Infra Red gas detectors utilise the latest technology to provide small format high reliability gas detection in an ATEX package. High stability is ensured by using dual beam technology with dual detectors for sample and reference channels. Temperature compensation and linearity correction are built in giving a fully linearised output. The basic detector is available as a three wire 4-20mA transmitter with the option for a fully digitally addressable version for use with the latest IGD systems. Detectors are supplied pre-calibrated for the chosen range and target gas.

General Specification

Power supply	18 to 28V DC
Electrical Outputs	3 Wire 4-20mA (4 Wire Addressable Option)
Temperature	-10°C to +55°C
Humidity	15 to 90% RH non-condensing
Ingress Protection	IP66
Housing Material	Stainless Steel 316 S16
Protection Concept	Flameproof
Dimensions (mm)	50 Diameter x 80 Length
Mounting Thread	M20 x 1.75
Weight	550 grams (Infra Red)

ATEX Approved
IECEX Approved

Ex db IIC T6 Gb Ta = -20° to +40°C
Ex tb IIIC T85°C Db IP66
Ex db IIC T5 Gb Ta = -20° to +55°C
Ex tb IIIC T100°C Db IP66
IECEX EXV16.0003X Rating 2W
ExVeritas 16ATEX 0141X



OLIVER IGD
Triton House
Crosby Street
Stockport
SK2 6TS
England

Tel: +44 (0)161 483 1415
Fax: +44 (0) 161 484 2345
Email: sales@internationalgasdetectors.com
Website: www.internationalgasdetectors.com



FS646773
Ref ROS165B

EC Declaration of Conformity

Issuers name and address:

Oliver IGD Limited of
Triton House
Crosby St,
Stockport,
United Kingdom



TOCSIN 102IR

Infra Red point flammable hydrocarbon gas detector
certified for use in potentially explosive atmospheres

Are in conformity with the provisions of the following European Directive(s) when installed, operated, serviced and maintained in accordance with the installation and operating instructions contained in the product documentation.

2004/108/EC **EMC Directive**
94/9/EC **ATEX Directive**

And that the standards and/or technical specifications referenced below have been applied or considered.

EN 60079-0:2012	Equipment for use in explosive atmospheres. General requirements
EN 60079-1:202014	Equipment for use in explosive atmospheres. Flameproof enclosures 'd'
EN 60079-31:2014	Equipment for use in explosive atmospheres. Housing Markings
EN 61241-0:2006	Electrical apparatus for use in the presence of combustible dust. General Requirements
EN 61241-1:2004	Electrical apparatus for use in the presence of combustible dust. Protection by enclosures "tD"
EN 61779-1:2000	Electrical apparatus for the detection and measurement of flammable gases
EN 50271:2010	Electrical apparatus for the detection and measurement of combustible gases, toxic gases or Oxygen: requirements and tests for apparatus using software and or digital technologies. <i>Excluding requirements for SIL</i>
EN 61000-6-2: 2005	EMC Generic standards. Immunity for industrial environments
EN 61000-6-4: 2007	EMC Generic standards. Emission standard for industrial environments
EN 61000-3-2/A2: 2009	EMC Limits. Limits for harmonic current emissions (equipment input current ≤ 16 A per phase)
EN 61000-3-3: 2008	EMC Limits. Limitation of voltage changes, voltage fluctuations and flicker in public low-voltage supply systems, for equipment with rated current ≤ 16 A per phase
Technical File references	T102A-TF9 Technical construction File AD197 ATEX Approval Document File

Product Markings

Serial Number- xxxxxxYear

ATEX Approved
IECEX Approved



Ex db IIC T6 Gb Ta = -20° to +40°C
Ex tb IIIC T85°C Db IP66
Ex db IIC T5 Gb Ta = -20°to +55°C
Ex tb IIIC T100°C Db IP66
IECEX EXV16.0003X Rating 2W
ExVeritas 16ATEX 0141X



Oliver IGD Limited Operate and Independently assessed ATEX/IECEX QAN.

Quality Assurance Certificate Number
ExVeritas 16PQAN0014

Quality Assurance Notification Number:
2585

ExVeritas,
Units 16-18,
Abenbury Way,
Wrexham Industrial Estate,
Wrexham, UK, LL13 9UZ

Oliver IGD Limited operate an independently assessed ISO9001:2008 Quality Management System.

Quality Management Certificate Number
FS 646773

BSI Assurance UK LTD,
Chiswick High Road,
London
W4 4AL
UK

Testing Agency:

TUV - SUD
Octagon House
Concorde Way
PO 15 5RL
Fareham



Mehr Sicherheit.
Mehr Wert.

IECEX Certificate can be checked on-line at

<http://iecex.iec.ch/iecex/iecexweb.nsf/421ce8815c53a3afc1257a1e00576486/9486b8f805dc1047c1257f48005165c0?OpenDocument>

TUV Certificates and reports can be checked on-line at https://www.tuev-sued.de/industry_and_consumer_products/certificates

Issued by: Oliver IGD Limited, Stockport, SK2 6TS , United Kingdom

Signature:

Declaration of Conformity in accordance with EN ISO/IEC 17050-1:2010

Name

Andrew J Collier M.I.O.D

Position:

Managing Director

Date: 10.June 2016

Declaration Ref: 102IRCE-4



International Gas Detectors

CH₄ H₂S CO₂
NO₂ SO₂ O₂



Triton House
Crosby Street
Stockport
SK2 6TS
England

Tel: +44 (0)161 483 1415

Fax: +44 (0) 161 484 2345

Email: sales@internationalgasdetectors.com

Website: www.internationalgasdetectors.com



FS646773
Ref ROS165B

TOCSIN 102

Infra Red Point Gas Detectors

The Tocsin 102IR series of gas detectors uses the proven Non-Dispersive (NDIR) principle to detect and monitor the presence of gases.

The detectors are supplied as pre-calibrated units with linear 4-20mA outputs. If necessary the detector head can be field calibrated or re-configured for different gases or ranges using its inbuilt serial port and separate data terminal. The infra red detectors employed have been field proven over many years use resulting in a series of detector heads with excellent stability and reliability in the most arduous conditions. The detector heads have their own control software which continually monitors the head performance. This ensures that in the unlikely event that a fault occurs it is detected and reported immediately. Using the inbuilt serial port this series of detector heads can be integrated onto addressable systems such as the Tocsin 625,700 or 920 control panels allowing sensors to be 'daisy' chained for ease of installation and operation.

- **LONG MTBF**

EXTENDED CALIBRATION PERIODS

ALL STAINLESS STEEL CONSTRUCTION

ADDRESSABLE SERIAL PORT

- **CAN BE FIELD CALIBRATED**

- **LINEAR 4-20mA OUTPUT**

- **AVAILABLE FOR A WIDE RANGE OF FLAMMABLE GASES AND CO2**

Performance	
Operation	Continuous
Resolution	2%FSD
Warm up time to final zero	< 20 s
Warm up time to specification	< 30 minutes
Response time to target gas T90	< 20 s
MTBF	> 5 years
Long Term Zero Drift Per Month	+/-0.05%
Zero Repeatability During Operation	+/-0.1%
Span (5%) Repeatability During Operation	+/-0.1%
Environmental:	
Operating Temperature	-10 to +55 Deg C
Storage Temperature	-20 to +60 Deg C
Relative humidity (non-condensing)	0 to 100%
Connections	
Outputs	3 Wire 4-20mA
Power Input	18 to 32V DC
Power Consumption	90mW
Physical	
Ingress Protection	IP66
Housing Material	Stainless Steel 316 S16
Protection Concept	Flameproof
Dimensions (mm)	50 Diameter x 80 Length
Mounting Thread	M20 x 1.75
Weight	550 grams

Gases, Ranges and Order Codes

Sensor type	Basic Part Number	Suffix 'A' For Addressable Sensor	Min Range	Max Range
Flammable Gases Infra-Red Point Methane Petrol Vapour Propane Common Solvents n-Butane Kerosene n-Pentane Ethylene n-Hexane Benzene	5107901	A		0-100%LEL 0-100%Vol
Carbon Dioxide Infra-Red Point	5112701 5112702	A A		0-5000ppm 0-5% 0-100%

METHANE
 PROPANE
 BUTANE
 PENTANE
 HEXANE
 ETHYLENE
 BENZENE
 AIRCRAFT FUEL JP-4
 PETROL VAPOURS



International Gas Detectors



Triton House
 Crosby Street
 Stockport
 SK2 6TS
 England

Tel: +44 (0)161 483 1415

Fax: +44 (0) 161 484 2345

Email: sales@internationalgasdetectors.com

Website: www.internationalgasdetectors.com




FS646773

Ref ROS165B

TOCSIN 102

SENSOR OPTIONS & ACCESSORIES

TOCSIN 102 SHOWN WITH EExd JUNCTION BOX

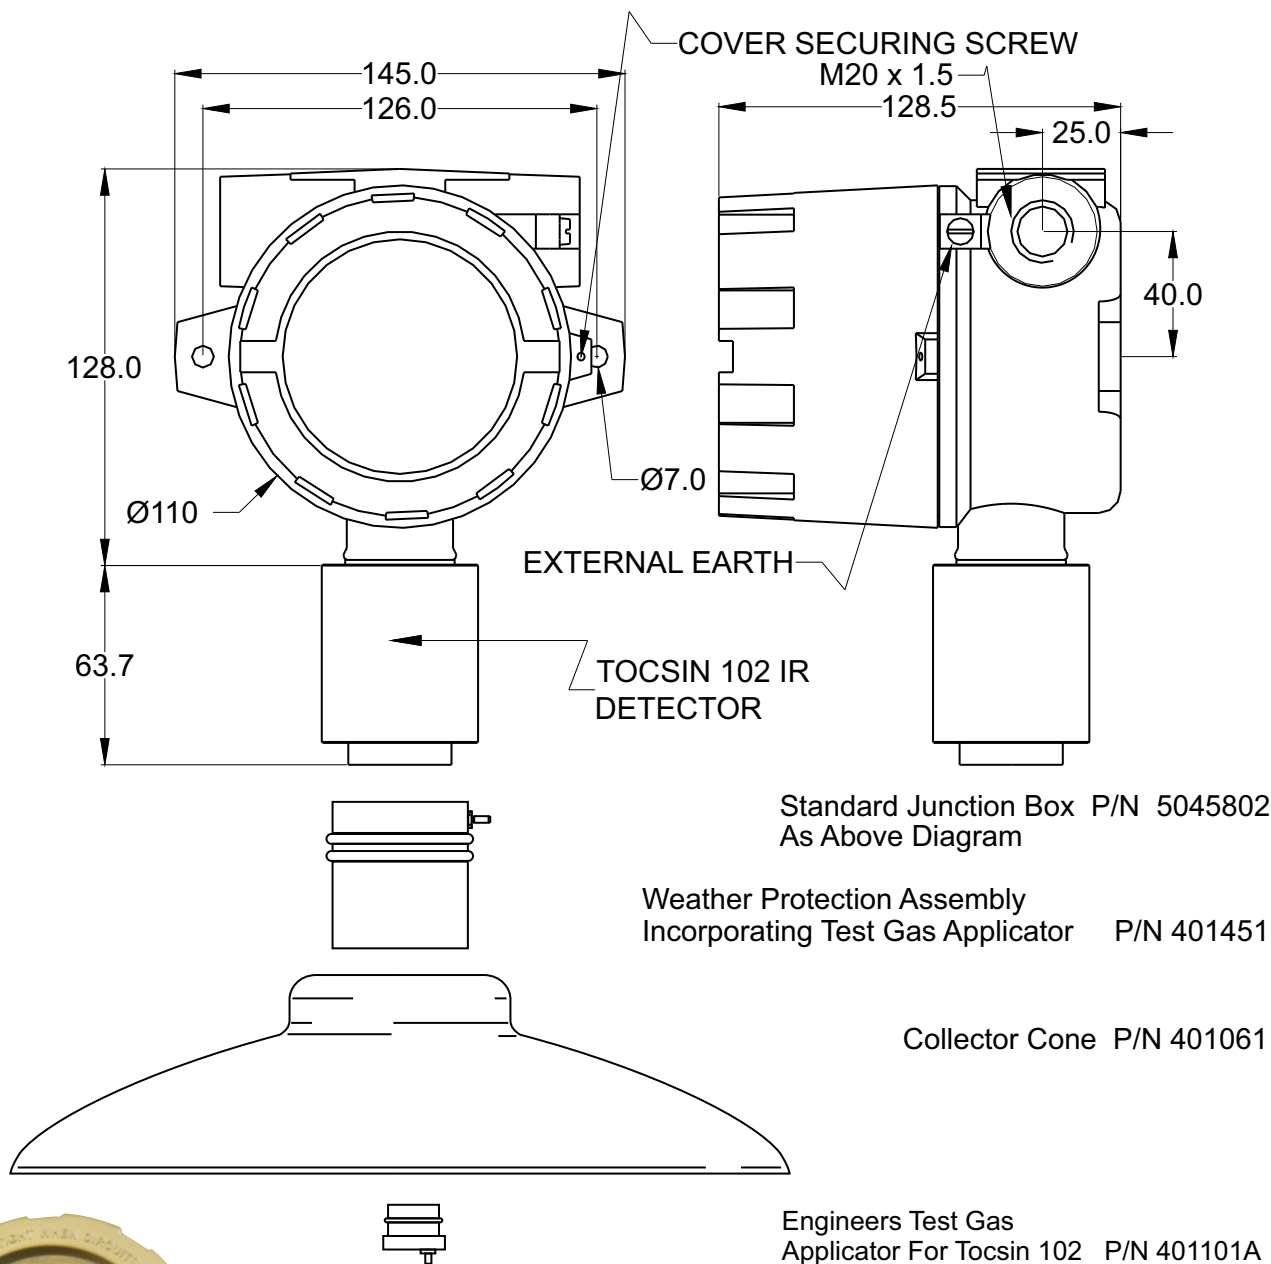

Tocsin 102 Series H2S Detector
Fitted With 903 Series EXd
Single Channel Controller

For Compatible Oliver IGD Control Panels See:

- The Tocsin 625 Small System controller
- The Tocsin 700 One to 64 Channel Controller
- The Tocsin 920 Addressable System Controller
- The Tocsin 903 EEx Single Channel Controller